

## HIT Centrifugal In-Line Fan

1. **WARNING** This fan is fitted with a non self-resetting thermal cut-out which switches the fan off in the event of a fault condition. To reset, turn the power off for one minute, then back on. Only a suitably qualified and competent person may carry out maintenance after the electrical supply has been isolated.

**CAUTION** In order to avoid a hazard due to inadvertent resetting of the thermal cut-out, this appliance must not be supplied through an external switching device, such as a timer, or connected to a circuit that is regularly switched on and off by the utility.

**WARNING** The appliance can only be used indoors.

### 2. General

- 2.1 It is important these Installation and Maintenance Instructions are fully adhered to.
- 2.2 Full details of the unit supplied are shown on the product nameplate. If in doubt about any detail contact Hydor or its agents for clarification.
- 2.3 All electrical installation must be carried out by suitably qualified and competent personnel in accordance with all current statutory requirements.
- 2.4 These instructions cover only the Hydor product and do not include the supply or installation of any safety equipment that may be required e.g. adequate guarding or protection from rotating parts and proper electrical isolation.
- 2.5 Any declarations made by Hydor about product installation and safety, are dependent on the fan equipment being used within installations which themselves meet the requirements of the relevant Standards and Directives of your region.
- 2.6 The fan is designed for use in up to 95% relative humidity. The fan is not suitable for corrosive or explosive atmospheres.
- 2.7 The installer should provide easy access to the fan to facilitate future maintenance.
- 2.8 The installer should ensure the fan is adequately supported.
- 2.9a **The below statement is only applicable to the European market.**  
This appliance can be used by children aged from 8 years and above and persons with reduced physical, sensory or mental capabilities or lack of experience and knowledge if they have been given supervision or instruction concerning use of the appliance in a safe way and understand the hazards involved. Children shall not play with the appliance. Cleaning and user maintenance shall not be made by children without supervision.
- 2.9b **The below statement is only applicable to the non-European market.**  
This appliance is not intended for use by persons (including children) with reduced physical, sensory or mental capabilities, or lack of experience and knowledge, unless they have been given supervision or instruction concerning use of the appliance by a person responsible for their safety. Children should be supervised to ensure that they do not play with the appliance.

- 2.10 Means for electrical disconnection must be incorporated in the wiring installation in accordance with the relevant wiring and electrical regulations.

**WARNING** The fan must be isolated from the power supply during installation and maintenance. The fan must be earthed in accordance with the local regulations.

- 3.**
- 3.1 Refer to the appropriate wiring diagram. Ensure that all earth connections are made.
  - 3.2 The fan is to be installed so that the blades are more than 2.3m above the floor (for fans intended to be mounted at high level).
  - 3.3 Precaution must be taken to locate the exhaust discharge terminal so as to avoid the backflow of gases into the room from the open flue of gas or other fuel burning appliances.

Installation and Maintenance Instructions.

**THESE INSTRUCTIONS MUST BE READ FULLY BEFORE COMMENCING INSTALLATION.**


**Owner / installer:** The life of this apparatus and its efficiency will be increased if its use and maintenance is carried out in accordance with these instructions and current statutory requirements. The installation and initial adjustments should be carried out by a qualified and competent technician. Hydor Limited should be consulted before substituting or fitting parts from another manufacturer. It is the responsibility of the installer to verify that the installation is in accordance with the following standards and the owner is given the current User's Manual.

**Any modifications to the fan or its installation, even the smallest modification, change or elimination of security components or pieces that influence the efficiency or loss of ventilation, will result in Hydor's warranty being cancelled.**

- 4. Installation**
- 4.1 Upon receipt, the fan equipment should be visually inspected to check for any damage. Ensure that the impeller is free to rotate.
  - 4.2 If there are any queries concerning the fan equipment, Hydor should be contacted prior to the installation.
  - 4.3 Use the mounting bracket set supplied with the HIT fan to fix the fan in the desired position to suit the application. The fan can be mounted at any angle. If the fan is mounted with vertical outlet, a weather proof cover must be installed at the ducted outlet.

### HIT100, HIT125, HIT150 and HIT160

Screw bracket side to fan using self tapping screws. (a)

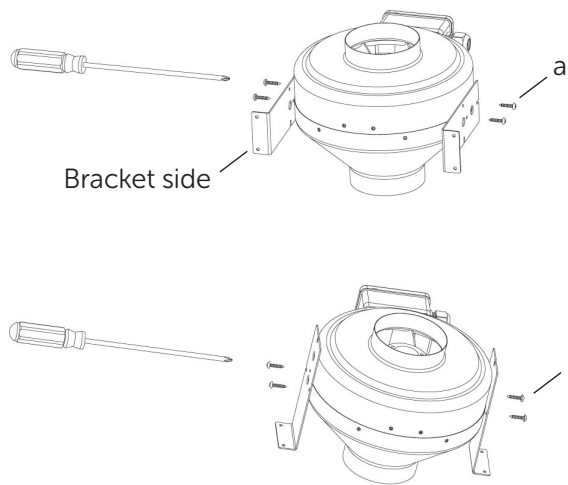

#### Mounting bracket set (supplied)

HIT100, HIT125, HIT150 and HIT160 2 off bracket sides.

#### Fixings set (supplied)

- a. 4 off M4x8mm Phillips hexagon with pad flange head self tapping screws




#### Tool requirements (not supplied)

Phillips head point size #1 screw driver



### HIT200, HIT250 and HIT315

Screw bracket side to fan using self tapping screws. (a) Bolt the bracket support/spacer using the button head screws.

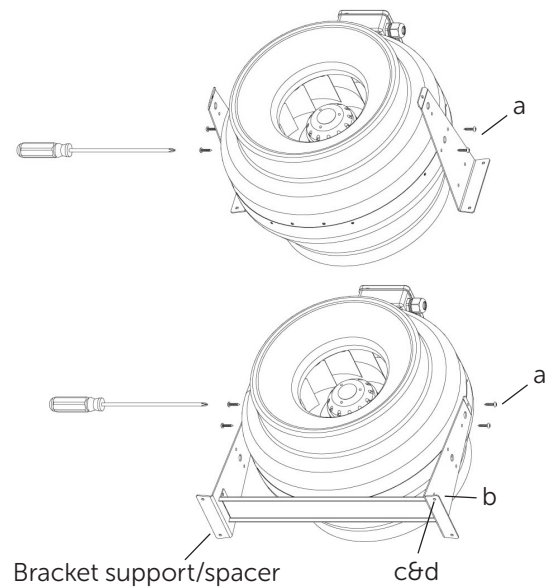


#### Mounting bracket set (supplied)

HIT200, HIT250 and HIT315 2 off bracket sides, 1 off bracket support/spacer.


#### Fixings set (supplied)

- a. 4 off M4x8mm Phillips hexagon with pad flange head self tapping screws
- b. 4 off M4x15mm button head screws
- c. 4 off M4 hexagon nuts
- d. 4 off flat washers




#### Tool requirements (not supplied)

Phillips head point size #1 screw driver  
7mm Hexagon Socket Wrench or Spanner  
Hand Tool



- 4.4 A minimum of 1 metre of duct at least the same diameter as the fan spigots diameter is to be fitted to the fan inlet and discharge spigots. Fans can be pushed directly into the duct and fastened. Make sure the ducting system is not deformed or twisted. For mounting, we recommend using cushioned fast clamps to reduce noise transmission into the ducting system. This requires a tool for fixing.
- 4.5 Minimum 150mm clearance between the fan and the surrounding structure should be reserved. See dimensional data section 7.
- 4.6 Each HIT unit comes pre-fitted with an M20 cable gland, tightened to the terminal box to 50N force. Suitable for receiving a HO5VV-F 3 x 0.5-1.5mm<sup>2</sup> cable between 7mm minimum diameter and 10mm maximum diameter. Strip the cable outer sheath exposing the individual cable cores. Leaving sufficient space for the cables to be separated and fixed into the terminal strip connections. Strip each individual core back 10mm, exposing the cable.

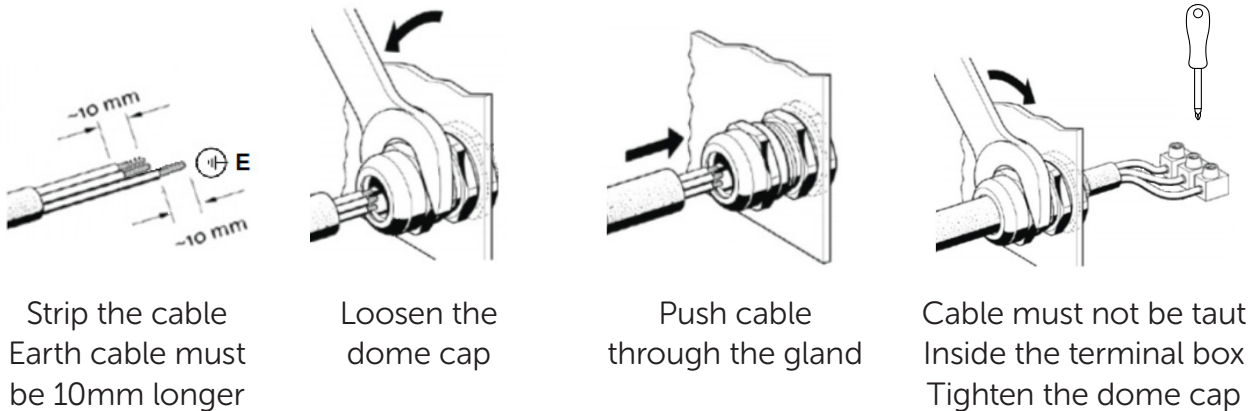


Ensure the dome cap is tightened enough that the cable is securely clamped and cannot move.

**Tool requirements (not supplied)**

24mm Spanner

Terminal screw driver



- 4.7 If the supply cord is damaged, it must be replaced by the manufacturer, its service agent or similarly qualified persons in order to avoid hazards.
- 4.8 Check the details on the motor rating plate to ensure that the correct power supply (voltage, frequency and phase) is available. An incorrect power supply will lead to permanent damage to the fan motor.
- 5. Start-up**
- 5.1 Before power is supplied to the unit, check that the wiring is correct as per the fan connection diagram.
- 5.2 At initial start-up, check that impeller rotation and airflow direction is correct.
- 5.3 Check that the motor amperage draw does not exceed the nameplate rating.

## 6. Fan Maintenance

- 6.1 Inspection of the fan at least once every 12 months is recommended to ensure that the motor, fan blades, and supporting guards, are clean. Any build up of dust and deposits on the blades or guards should be removed using a non-abrasive cleaner.
- 6.2 All fastenings should be checked for tightness. In addition, all rotating items should be checked.
- 6.3 Bearings are of the 'sealed for life' type and will not need a detailed inspection.

### General Sales

Article No.	Code	Supply	FL Amps	Watts	r/min
007580	HIT100	220-240V/1Ph/50-60Hz	0.14-0.13	26-25	2725-3150
007578	HIT125	220-240V/1Ph/50-60Hz	0.14-0.12	26-25	2690-3200
HIT150	HIT150	220-240V/1Ph/50-60Hz	0.28-0.36	65-84	2595-2858
007414	HIT160	220-240V/1Ph/50-60Hz	0.24-0.30	55-70	2700-3100
007133	HIT200	220-240V/1Ph/50-60Hz	0.46-0.60	105-130	2565-2900
007667	HIT250	220-240V/1Ph/50-60Hz	0.48-0.57	106-130	2555-2950
007581	HIT315	220-240V/1Ph/50-60Hz	0.69-0.84	158-182	2190-2600


### Qatar

Article No.	Code	Supply	FL Amps	Watts	r/min
007767	HIT100	240V/1Ph/50Hz	0.14	26	2725
007768	HIT125	240V/1Ph/50Hz	0.14	26	2690
007769	HIT150	240V/1Ph/50Hz	0.28	65	2595
007770	HIT160	240V/1Ph/50Hz	0.24	55	2700
007771	HIT200	240V/1Ph/50Hz	0.46	105	2565
007772	HIT250	240V/1Ph/50Hz	0.48	106	2555
007773	HIT315	240V/1Ph/50Hz	0.69	158	2190

### Saudi Arabia


Article No.	Code	Supply	FL Amps	Watts	r/min
007774	HIT100	220V/1Ph/60Hz	0.13	25	3150
007775	HIT125	220V/1Ph/60Hz	0.12	25	3200
007776	HIT150	220V/1Ph/60Hz	0.36	84	2858
007777	HIT160	220V/1Ph/60Hz	0.30	70	3100
007778	HIT200	220V/1Ph/60Hz	0.60	130	2900
007779	HIT250	220V/1Ph/60Hz	0.57	130	2950
007780	HIT315	220V/1Ph/60Hz	0.84	182	2600

## 7. Dimensional Data

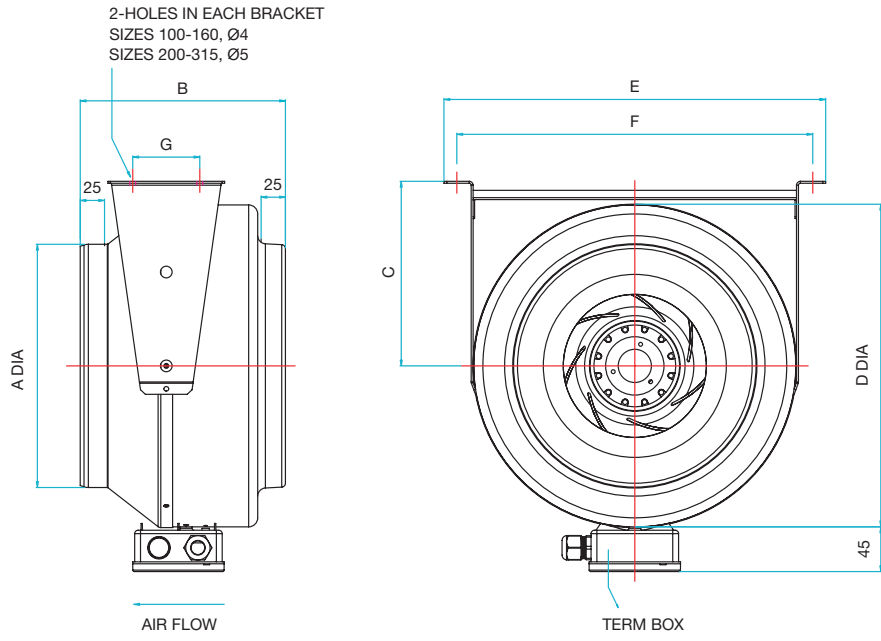


Product Code	A	B	C	D	E	F	G	Weight kg
HIT100	98	204	130	237	284	270	47	3.7
HIT125	123	202	130	237	284	270	47	3.7
HIT150	148	195	165	278	326	312	47	3.6
HIT160	158	195	165	278	326	312	47	3.6
HIT200	198	242	190	333	392	372	100	5.5
HIT250	248	210	190	333	392	372	100	5.3
HIT315	313	280	227	400	460	440	100	8.8


### 7.1 Minimum space required for installation

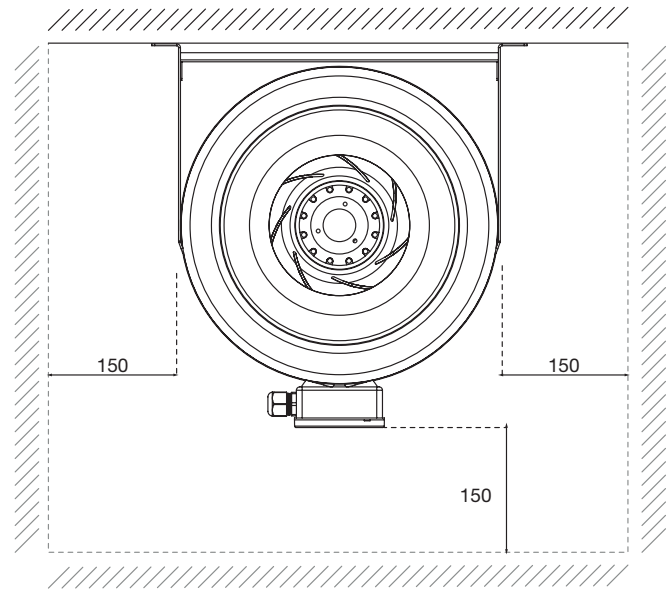

**8. Wiring**  
**8.1 HIT 100 - 125**

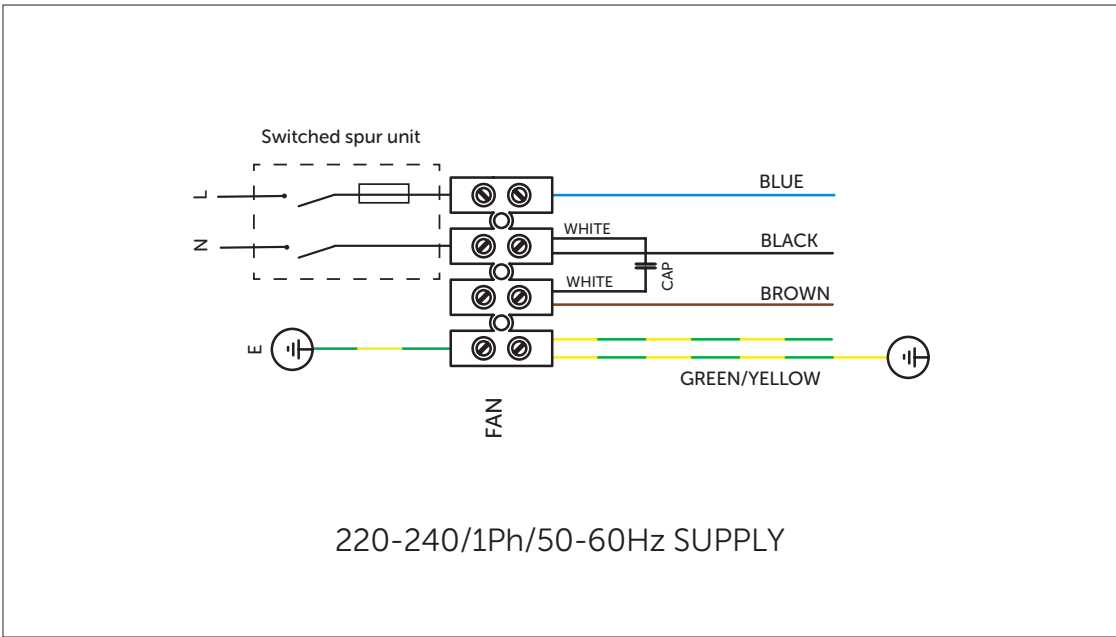

**8.2 HIT 150 - 315**

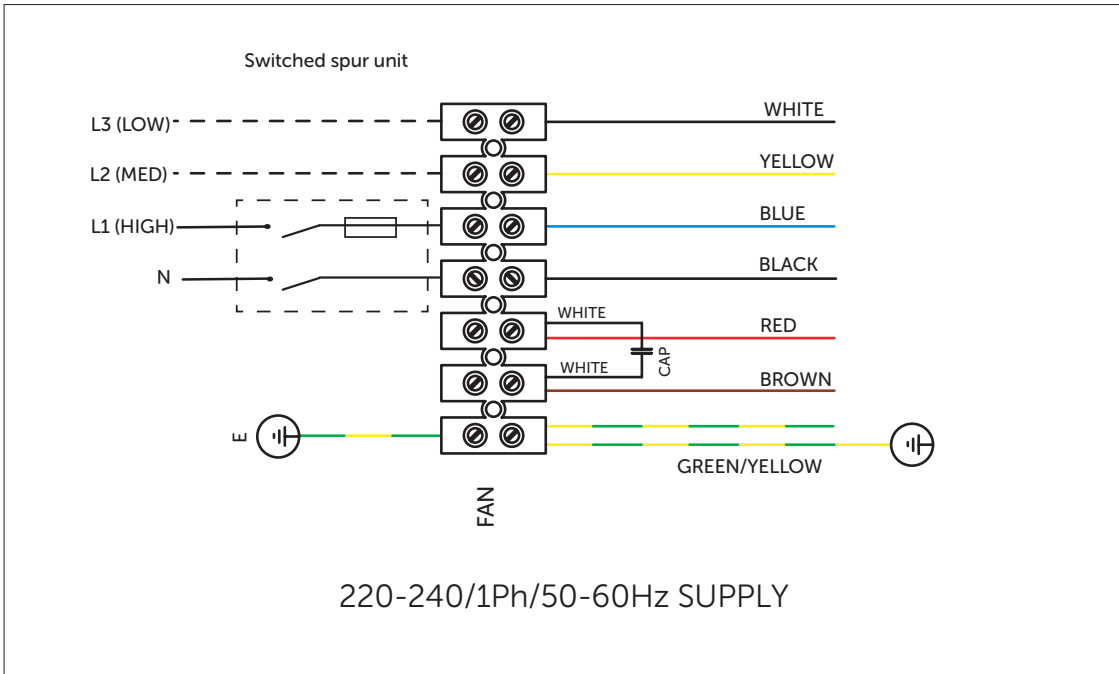

## **Guarantee**

Hydor or its agents will, within a period of one year from the date of dispatch from their works, at its option, replace any goods, which are proven to have defects as a result of defective materials or workmanship. The goods must be inspected by a Hydor official and if necessary returned, with a Returns Note Number, carriage paid, for further examination.

Hydor Ltd

## **Hydor**

Unit 8, Parkers Close, Downton  
Business Centre, Downton,  
Salisbury, Wiltshire, SP5 3RB, UK

Tel: +44 (0) 1725 511422  
Email: [info@hydor.co.uk](mailto:info@hydor.co.uk)  
Web: [www.hydor.co.uk](http://www.hydor.co.uk)

## **idealair group**

Unit 1, Building 1, Sydney  
Corporate Park, 85 O'Riordan Street,  
Alexandria NSW 2015

Tel: +61 (02) 8073 3310  
Fax: +61 (02) 8073 3320  
Email: [info@idealairgroup.com.au](mailto:info@idealairgroup.com.au)  
Web: [idealairgroup.com.au](http://idealairgroup.com.au)

## **AMS**

11 Ingrid Road, Montague Gardens,  
7442 Cape Town, Western Cape

Tel: +27 (0) 21 552 1077  
Fax: +27 (0) 21 552 2797  
Web: [fans.co.za](http://fans.co.za)

## **Elta Fans (Building Services)**

46 Third Avenue, Pensnett Trading  
Estate, Kingswinford, West Midlands,  
DY6 7US, UK

Tel: +44 (0) 1384 275800  
Fax: +44 (0) 1384 275810  
Email: [bs@eltafans.co.uk](mailto:bs@eltafans.co.uk)  
Web: [www.eltafans.com](http://www.eltafans.com)

## **Elta Fans (Applied Technology)**

17 Barnes Wallis Road, Segensworth East  
Industrial Estate, Fareham,  
Hampshire, PO15 5ST, UK

Tel: +44 (0) 1489 566500  
Fax: +44 (0) 1489 566555  
Email: [at@eltafans.co.uk](mailto:at@eltafans.co.uk)  
Web: [www.eltafans.com](http://www.eltafans.com)

## **Elta Fans (Export)**

17 Barnes Wallis Road, Segensworth East  
Industrial Estate, Fareham,  
Hampshire, PO15 5ST, UK

Tel: +44 (0) 1489 566500  
Fax: +44 (0) 1489 566555  
Email: [export@eltafans.co.uk](mailto:export@eltafans.co.uk)  
Web: [www.eltafans.com](http://www.eltafans.com)